


AD Enclosure - PBar Rings

Search and Secure Procedure

Pbar Rings

PbarRings.V1.0

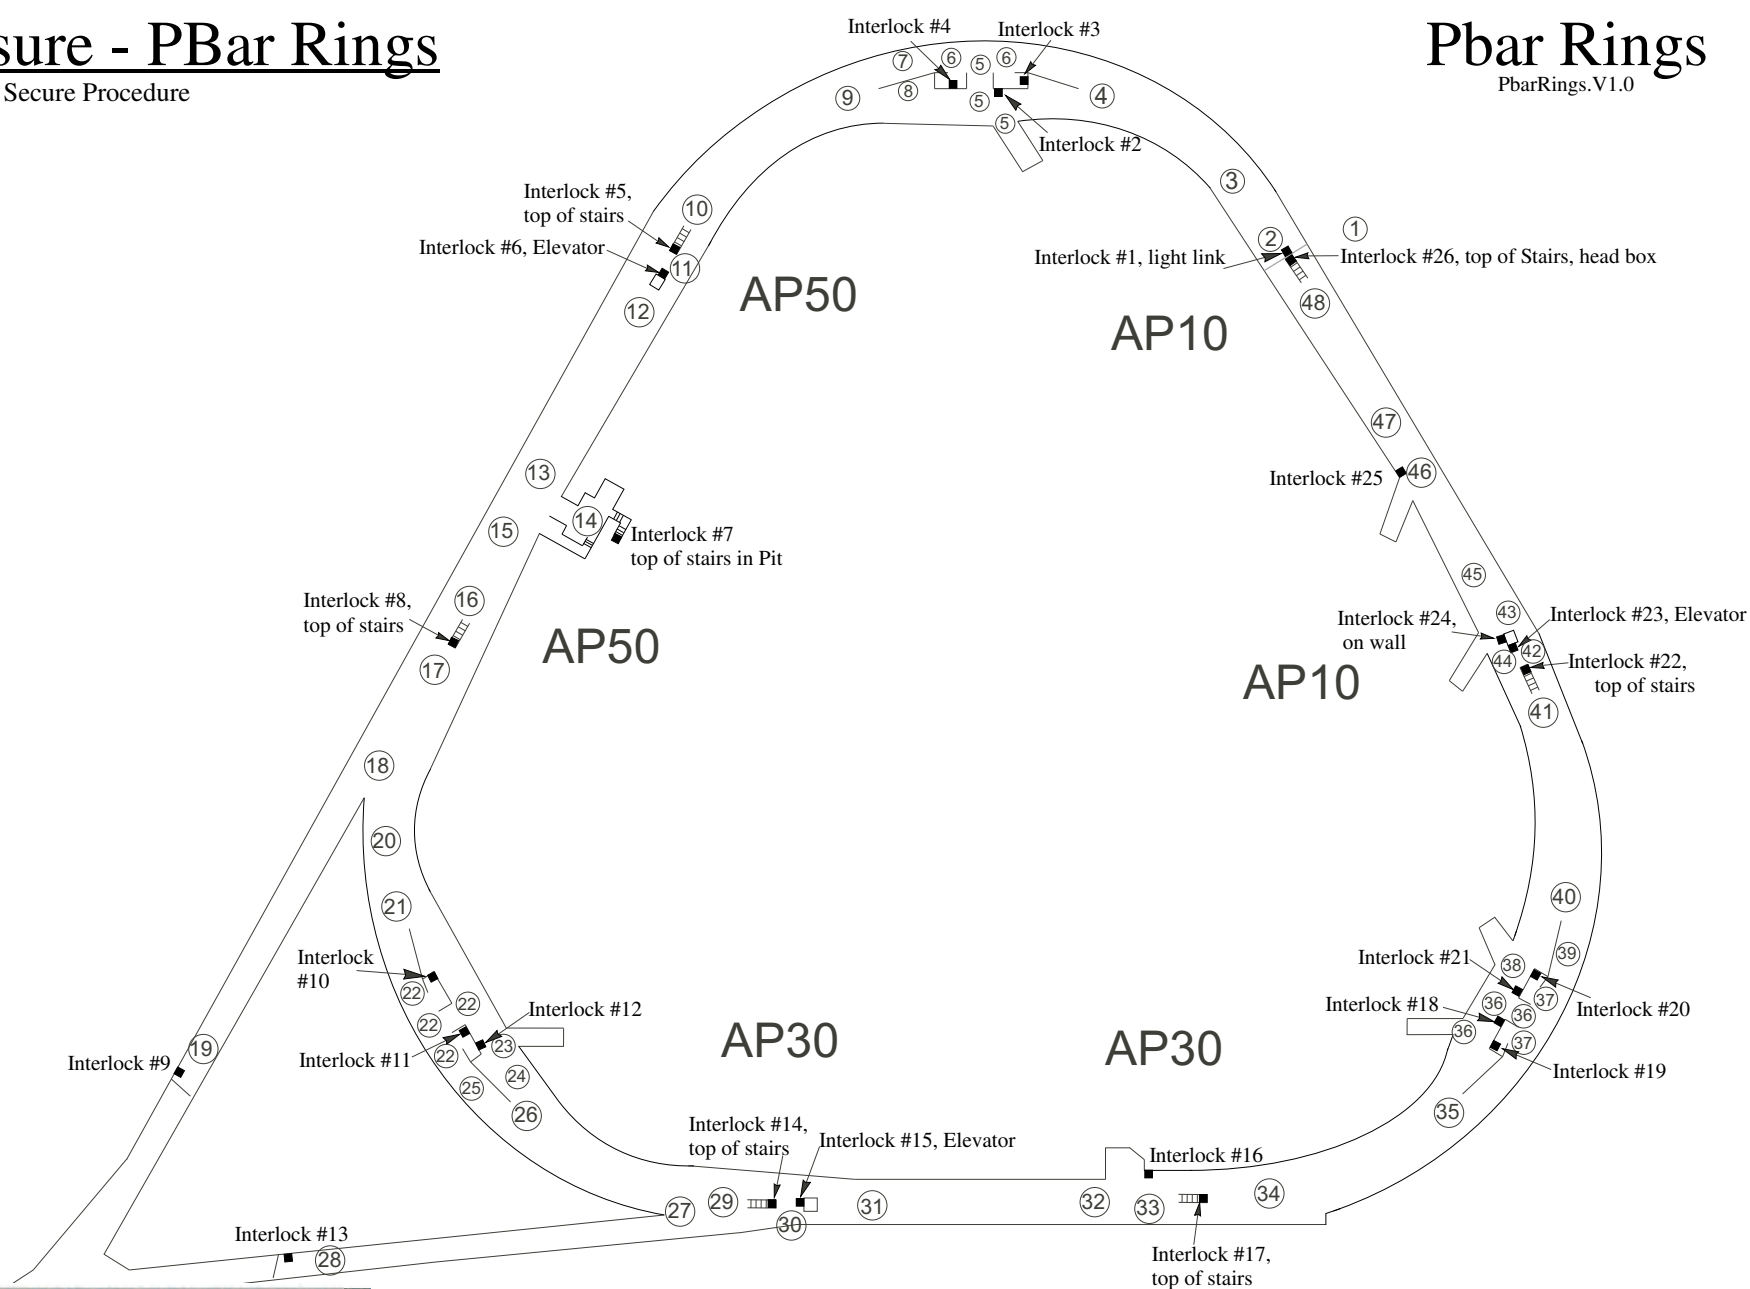

Reviewed AD/RSO

Date

Michael A. Gerardi

4-1-09

Approved AD/OPS Dept. Head

Date

[Signature]

4-2-09

See next page for Procedure.

CONTROLLED DOCUMENT

Users are responsible for ensuring they work to the latest approved revision. Printed or electronically transmitted copies are uncontrolled.

spb 5 March 2008
Version 1.0

Pbar Rings Search & Secure Procedure

- 1) "A" and "B" enter from the South side of AP10.
- 2) "A" and "B" enter the tunnel, reset and test Interlock Box #1, a light link.
- 3) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 4) At the Emergency Exit Area, "A" and "B" split, "A" goes to the left and "B" goes to the right.
- 5) "A" and "B" make eye contact at the opening. "B" holds while "A" checks the alcove and resets Interlock Box #2, the re-makes eye contact with "B".
- 6) "A" holds while "B" checks the Emergency Exit ladder and resets Interlock Box #3, then proceeds to check the air handler area and resets Interlock Box #4, then re-makes eye contact with "A"
- 7) "A" continues to sweep the area and join "B" at point 9.
- 8) "B" continues to sweep the area and join "A" at point 9.
- 9) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 10) "A" holds while "B" checks the stairway, exit to AP50, and resets Interlock Box #5.
- 11) "A" and "B" check both side and behind the stairwell, "B" checks that the Elevator is down and empty, then resets Interlock Box #6.
- 12) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 13) "A" hold at the entrance to the Pit Area.
- 14) "B" checks the Pit Area and resets Interlock Box #7, at the top of the stairs.
- 15) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 16) "A" holds while "B" sweeps the stairwell exit to AP50 and reset Interlock Box #8. When "B" comes back down they split up to check both sides and the back of the stairwell.
- 17) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 18) "A" holds while "B" sweeps the AP2 tunnel to reset Interlock Box #9.
- 19) "B" sweeps the tunnel to reset Interlock Box #9.
- 20) "B" joins "A" and they sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 21) At the Emergency Exit Area, "A" and "B" split, "A" goes to the left and "B" goes to the right.
- 22) "A" and "B" make eye contact, A holds while "B" checks the Emergency Exit ladder and resets Interlock Box #10, then proceeds to check the air handler area and resets Interlock Box #11, then re-makes eye contact with "A".
- 23) "B" holds while "A" reset Interlock Box #12 and checks the alcove.
- 24) "A" informs "B", sweeps the area and joins "B" at point 26.
- 25) "B" sweeps the area and joins "A" at point 26.
- 26) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 27) "A" holds while "B" sweeps the AP3 tunnel to reset Interlock Box #13.
- 28) "B" sweeps the tunnel to reset Interlock Box #13.
- 29) "B" joins "A" then "B" holds while "A" checks the stairway, exit to AP30, to reset Interlock Box #14.
- 30) "A" and "B" check both side and behind the stairwell. "B" checks that the Elevator is down and resets Interlock Box #15.
- 31) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 32) "A" holds while "B" checks the alcove on the left and resets Interlock Box #16.
- 33) "A" holds while "B" sweeps the stairwell exit to AP50 and reset Interlock Box #17. When "B" comes back down they split up to check both sides and the back of the stairwell.
- 34) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 35) At the Emergency Exit Area, "A" and "B" split, "A" goes to the left and "B" goes to the right.
- 36) "A" and "B" make eye contact, "B" holds while "A" checks the alcove and resets Interlock Box #18, then re-makes eye contact with "B".
- 37) "A" holds while "B" checks the Emergency Exit ladder and resets Interlock Box #19, then proceeds to check the air handler area and resets Interlock Box #20, then re-makes eye contact with "A"
- 38) "B" holds while "A" checks the alcove and resets Interlock Box #21. "A" informs "B" and joins "B" at point 40.
- 39) "B" sweeps the area and joins "A" at point 40.
- 40) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 41) "A" holds while "B" checks the stairway, exit to AP10, to reset Interlock Box #22.
- 42) "A" and "B" check both sides and behind the stairwell. "B" checks that the Elevator is down and empty then resets Interlock Box #23.
- 43) "B" holds while "A" checks the alcove, resets Interlock Box #24 informs "B" and joins "B" at point 45.
- 44) "B" sweeps the area and joins "A" at point 45.
- 45) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 46) "B" holds while "A" checks the the alcove on the left and resets Interlock Box #25.
- 47) "A" and "B" sweep the tunnel, one checking the Accumulator side and the other the Debuncher side.
- 48) At the final stairwell "A" holds while "B" checks behind the stairwell, being careful not to drop the light link. Together they sweep the stairwell to reset Interlock Box #26, the head box and control access out.

See previous page for Map.